


PLAN VIEW

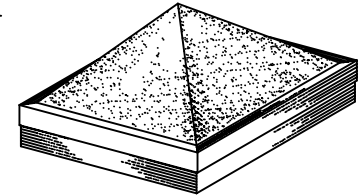

MODEL : PYDD-
 NET OPENING :
 UNITS REQUIRED :
 PYRAMID COLOR :
 FINISH :

SECTION VIEW - PYRAMID SKYLIGHT

SCALE : 1/2" = 1"

SPECIFICATIONS:

UNIT SHALL BE CONSTRUCTED OF 6063-T5 ALUMINUM EXTRUSION HAVING MINIMUM WALL THICKNESS OF .063. UNIT SHALL BE NEATLY FORMED AND FABRICATED WITH ALL JOINTS AND SEAMS COMPLETELY WELDED BY HELI-ARC PROCESS TO ENSURE MAXIMUM STRENGTH AND WATER TIGHTNESS. ACRYLIC PLASTIC DOME SHALL BE OF A THICKNESS AND CONFIGURATION TO CONFORM WITH U.B.C. REQUIREMENTS AND AAMA SPECIFICATIONS. UNIT SHALL BE SUPPLIED TO JOB READY FOR INSTALLATION.

CALIFORNIA STATE FIRE MARSHAL APPROVAL NO. 4350-054
 SEE I.C.B.O. ES APPROVAL NO. 1998
 CITY OF LOS ANGELES RESEARCH REPORT NO. RR-2708

 INDUSTRIAL LADDER & SCAFFOLDING <small>8152 BELVEDERE AVE SACRAMENTO, CA (916)452-0231</small>		<i>By Lane-Aire</i>
JOB	SHEET	
ARCH.	OF	
CONTR.	DWG. NO.	
SUB. CONTR.	PYDD	
DRAWN BY -	DATE:	SQR.