


PLAN VIEW
NOT TO SCALE

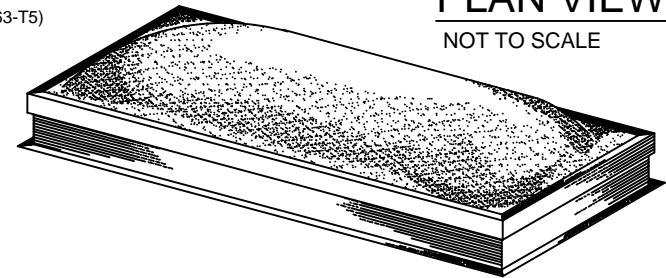

MODEL : SF-
 NET OPENING :
 UNITS REQUIRED :
 DOME COLOR :
 FINISH :

SECTION A-A = SELF - FLASHING DOME (SF)

SCALE : 1/2" = 1"

SPECIFICATIONS:

UNIT SHALL BE CONSTRUCTED OF 6063-T5 ALUMINUM EXTRUSION HAVING MINIMUM WALL THICKNESS OF .063. UNIT SHALL BE NEATLY FORMED AND FABRICATED WITH ALL JOINTS AND SEAMS COMPLETELY WELDED BY HELI-ARC PROCESS TO ENSURE MAXIMUM STRENGTH AND WATER TIGHTNESS. ACRYLIC PLASTIC DOME SHALL BE OF A THICKNESS AND CONFIGURATION TO CONFORM WITH U.B.C. REQUIREMENTS AND AAMA SPECIFICATIONS. UNIT SHALL BE SUPPLIED TO JOB READY FOR INSTALLATION.

CALIFORNIA STATE FIRE MARSHALL APPROVAL NO. 4350-054
 SEE I.C.B.O. ES APPROVAL NO. 1998
 CITY OF LOS ANGELES RESEARCH REPORT NO. RR-2708

INDUSTRIAL *By Lane-Aire*
LADDER & SCAFFOLDING
 8152 BELVEDERE AVE SACRAMENTO, CA (916)452-0231

JOB	SHEET
ARCH.	
CONTR.	DWG. NO.
SUB. CONTR.	
DRAWN BY	REC.
DATE:	